


ALTERNATE INLETS ø5" - USE ONE OF THREE KNOCKOUTS

TONGUE & GROOVE JOINT WITH POLYPROPYLENE BASED SEALER

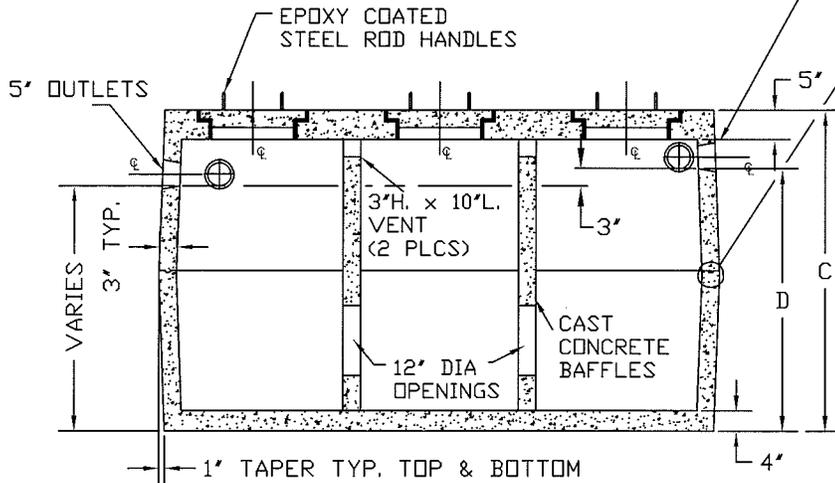

SECTION A-A

NOTES:

1. EXCAVATION MUST BE AT LEAST 12" WIDER & LONGER THAN TANK SIZE.
2. REINFORCED WITH 12.5 GA. 4" X 4" GALVANIZED WIRE & 3/8" RE-ROD.

LIQUID GALS.	A	B	C	D
	WIDTH	LENGTH	HEIGHT	INVERT
1000	62"	96"	66"	55"
1250	62"	96"	76"	65"



3584 Airline Road Muskegon, Michigan 49444
231-733-1904 1-800-TOO-BUSH
WWW.BUSHCONCRETEPRODUCTS.COM

1000-1250 Gal. 3 Compartment Grease Trap Precast Concrete

SIZE	DATE	DWG NO.	REV
A	12/02/05	005	
DRAWN BY: B. BUSH		SHEET	1 of 1